




WIRED REMOTE CONTROLLER

Installation and Owner's Manual

MODEL:

KJR-120X2/TFBG-E(12V)

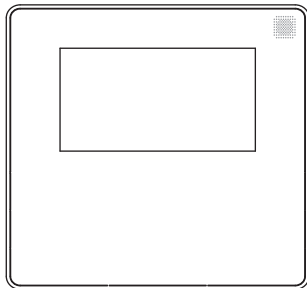

IMPORTANT NOTE:

Please read this manual carefully before installing or operating your wired remote controller. Make sure to save this manual for future reference.

This manual gives detailed description of the precautions that should be brought to your attention during operation.

In order to ensure correct service of the wired controller please read this manual carefully before using the unit.

For convenience of future reference, keep this manual after reading it.

All the pictures in this manual are for explanation purpose only. There may be slightly different from the wired remote controller you purchased (depend on model). The actual shape shall prevail.

Table of Contents

1. Safety precaution	1
2. Installation accessory	8
3. Installation method.....	10
4. Specification.....	16
5. Feature and function of the wired controller	17
6. Name on the LCD of the wired controller.....	18
7. Name of button on the wired controller.....	19
8. Preparatory operation	20
9. Operation	21
10. Timer functions	29
11. Weekly Timer 1	32
12. Weekly Timer 2	38
13. Fault alarm handing	45
14. Technical indication and requirement	45
15. Queries and settings	46

1. Safety precaution



WARNING

- Please entrust the distributor or professionals to install the unit.
- Installation by other persons may lead to imperfect installation, electric shock or fire.
- Adhere to this installation manual.
- Improper installation may lead to electric shock or fire.
- Reinstallation must be performed by professionals.

Do not uninstall the unit randomly.

Random uninstalling may lead to abnormal operation, heating or fire of the air condition.

NOTE

- Do not install the unit in a place vulnerable to leakage of flammable gases. Once flammable gases are leaked and left around the wire controller, fire may occur.
- Do not operate with wet hands or let water enter the wire controller. Otherwise, electric shock may occur.
- The wiring should adapt to the wire controller current. Otherwise, electric leakage or heating may occur and result in fire.

1. Safety precaution

NOTE

- The specified cables shall be applied in the wiring. No external force may be applied to the terminal. Otherwise, wire cut and heating may occur and result in fire.

(For North America area)



BATTERY WARNING



WARNING: Contains coin battery.



WARNING

INGESTION HAZARD: This product contains a button cell or coin battery.



BATTERY WARNING: KEEP OUT OF REACH OF CHILDREN;

- If the battery compartment (if applicable) does not close securely, stop using the product and keep it away from children;
- If you think batteries might have been swallowed or placed inside any part of the body, seek immediate medical attention.

1. Safety precaution



BATTERY WARNING

KEEP OUT OF REACH OF CHILDREN.

Swallowing can lead to chemical burns, perforation of soft tissue, and death. Severe burns can occur within 2 hours of ingestion. Seek medical attention immediately.



⚠ WARNING

- **INGESTION HAZARD:** This product contains a button cell or coin battery.
- **DEATH** or serious injury can occur if ingested.
- A swallowed button cell or coin battery can cause **Internal Chemical Burns** in as little as **2 hours**.
- **KEEP** new and used batteries **OUT OF REACH of CHILDREN**.
- **Seek immediate medical attention if a battery** is suspected to be swallowed or inserted inside any part of the body.



1. Safety precaution



WARNING

- Remove and immediately recycle or dispose of used batteries according to local regulations and keep away from children. Do NOT dispose of batteries in household trash or incinerate.
- Even used batteries may cause severe injury or death.
- Call a local poison control center for treatment information.
- Non-rechargeable batteries are not to be recharged.
- Do not force discharge, recharge, disassemble, heat above (-20-70°C) or incinerate. Doing so may result in injury due to venting, leakage or explosion resulting in chemical burns.
- Ensure the batteries are installed correctly according to polarity (+ and -).
- Do not mix old and new batteries, different brands or types of batteries, such as alkaline, carbon-zinc, or rechargeable batteries.
- Remove and immediately recycle or dispose of batteries from equipment not used for an extended period of time according to local regulations.

1. Safety precaution

- Always completely secure the battery compartment. If the battery compartment does not close securely, stop using the product, remove the batteries, and keep them away from children.
- Battery type: CR2032
- Battery nominal voltage: 3.0 V

(For other regions)



BATTERY WARNING



WARNING: Contains button or coin cell battery.

- **WARNING:** The battery is hazards and **KEEP OUT OF REACH OF CHILDREN**(Whether the battery is new or used).

If the battery compartment(if applicable) does not close securely, stop using the product and keep it away from children.

1. Safety precaution

- For appliances which contain coin or lithium batteries:



BATTERY WARNING

KEEP OUT OF REACH OF CHILDREN.

Swallowing can lead to chemical burns, perforation of soft tissue, and death. Severe burns can occur within 2 hours of ingestion. Seek medical attention immediately.



- For appliances which contain button or non-lithium batteries.
 - The battery can cause serious injuries if it is swallowed or placed inside any part of the body.
 - If you think batteries might have swallowed or placed inside any part of the body, seek immediate medical attention.

Battery Performance

- For more durable batteries, it is recommended to turn off the power when not in use for a period of time.

1. Safety precaution

! Battery Disposal

- Do not dispose of batteries as unsorted municipal waste. Refer to local laws for proper disposal of batteries.
- Batteries may have a chemical symbol at the bottom of the disposal icon. This chemical symbol means that the battery contains a heavy metal that exceeds a certain concentration. An example is Pb: Lead ($>0.004\%$).
- Appliances and used batteries must be treated in a specialized facility for reuse, recycling and recovery. By ensuring correct disposal, you will help avoid possible negative consequences for the environment and human health.



2. Installation accessory

Select the installation location

Don't install at the place where cover with heavy oil, vapor or sulfured gas, otherwise, this product would be deformed that would lead to system malfunction.

Preparation before installation

1. Please confirm that all the following parts you have been supply.

No.	Name	Qty.	Remarks
1	Wire controller	1	_____
2	Installation and owner's manual	1	_____
3	Screws	3	M3.9X25 (For Mounting on the Wall)
4	Wall plugs	3	For Mounting on the Wall
5	Screws	2	M4X25 (For Mounting on switch box)
6	Plastic screw bars	2	For fixing on switch box
7	Battery	1	_____
8	The connective wires group	1	Optional
9	Screw	1	M4X8(For Mounting the connective wire group)
10	Magnetic ring	1	Use the magnetic ring to hitch the connective cable of the wire controller.
11	Tapping lock screw and washer	1	M4X8 (For sheet metal of the indoor unit)

2. Installation accessory

2. Prepare the following assemblies on the site.

No.	Name	Qty.(embedded into wall)	Specification (only for reference)	Remarks
1	Switch box	1	_____	_____
2	Wiring Tube(Insulating Sleeve and Tightening Screw)	1	_____	_____

Precaution of installing the wire controller

1. This manual provides the installation method of wired controller. Please refer to the wiring diagram of this installation manual to connect the wire controller with indoor unit.
2. The wired controller works in low voltage loop circuit. Forbid to directly contact the cable of high voltage above, like 115V, 220V, 380V, and don't wire this kind of wire in the said loop; wiring clearance between configured tubes should be at the range of 300~500mm or above.
3. The Shielded wire of the wired controller must be grounded firmly.
4. Upon finish the wire controller connection, do not employed tramegger to detect the insulation.

3. Installation method

1.Wired remote controller structural dimensions

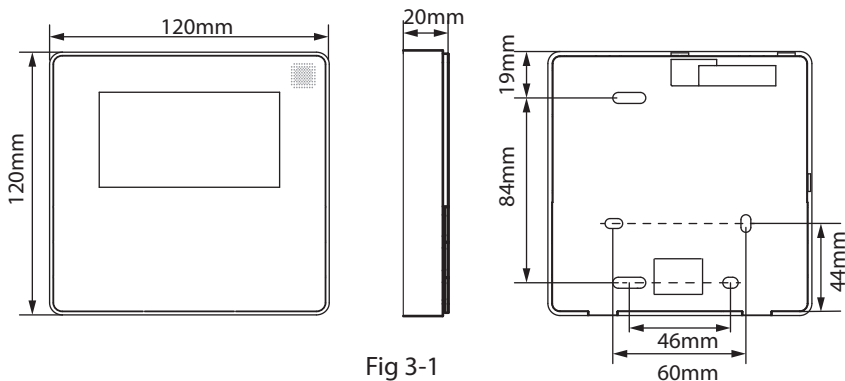


Fig 3-1

2.Remove the upper part of wired controller

- Insert a slot screwdriver into the slots in the lower part of the wired controller (2 places), and remove the upper part of the wire controller. (Fig.3-2)

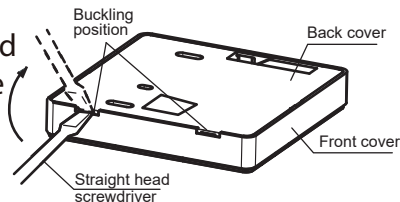


Fig 3-2

3. Installation method

NOTE: The PCB is mounted in the upper part of the wired controller. Be careful not to damage the board with the slot screwdriver.

3. Fasten the back plate of the wired controller

- For exposed mounting, fasten the back plate on the wall with the 3 screws (M4×20) and plugs. (Fig.3-3)

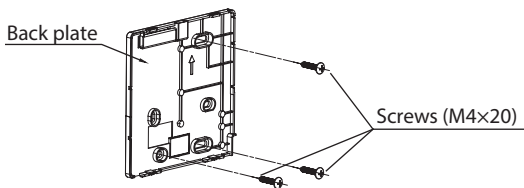


Fig 3-3

- Use two M4X25 screws to install the back cover on the 86 switch box, and use one M3.9X25 screw to fix to the wall.

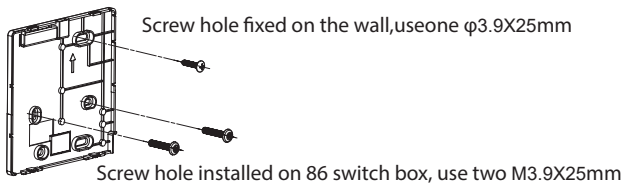


Fig 3-4

3. Installation method

NOTE: Put on a flat surface. Be careful not to distort the back plate of the wire controller by overtightening the mounting screws.

4. Battery installation





Fig 3-5

- Please contact professional technical after-sales service if the battery needs to be replaced.
- Put the battery into the installationsite and make sure the positive side of the battery is in accordance with the positive side of installationsite.(See Fig.3-5)
- Please set the time corrected on the first time operation. Batteries in the wire controller can time under power failure which ensure the time keep right. When the power restores, if the time displayed is not correct, it means the battery is dead and replace the battery.

3. Installation method

5. Wire with the indoor unit

A



B

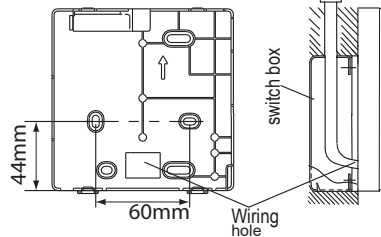


Fig 3-6

1 indoor unit

2 notch the part for the wiring to pass through with nippers, etc.

NOTE: DO NOT
allow water to enter
the remote control.
Use the trap and
putty to seal the
wires.


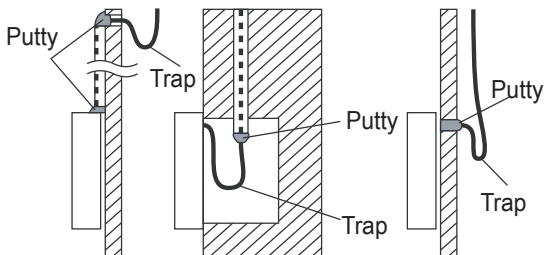


Fig 3-7

3. Installation method


6.Installation Diagram

Connect the wire from the display panel of the indoor unit to a connecting cable. Then connect the other side of the connecting cable to the remote control.

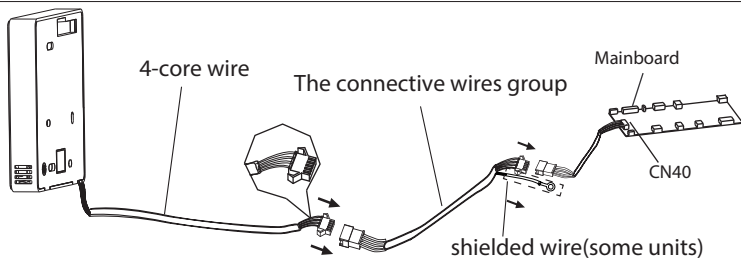

Applicable to Light Commercial air conditioner

Fig 3-8

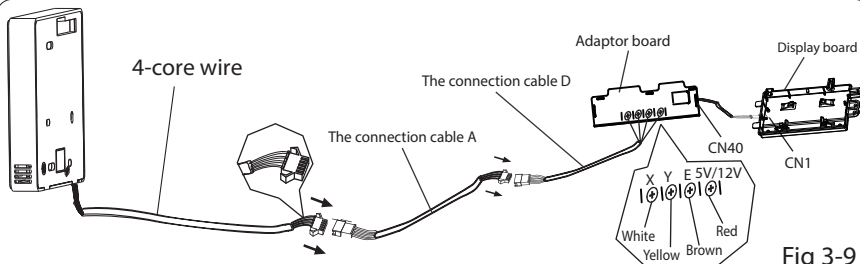

Applicable to split-type air conditioner

Fig 3-9

3. Installation method

NOTE: Be sure to reserve a length of the connecting wire for periodic maintenance.
If there is a connection lug at the end of shielded wire, the connection lug should be properly grounded.

7. Reattach the upper part of the wire controller

- After adjusting the upper case and then buckle the upper case; avoid clamping the wiring during installation. (Fig 3-10)

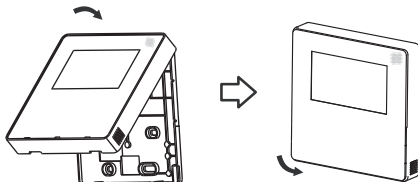


Fig 3-10

All the pictures in this manual are for explanation purpose only.
Your wire controller may be slightly different .The actual shape shall prevail.


4. Specification

Input voltage	DC 5V/12V
Ambient temperature	-5~43°C (23~110°F)
Ambient humidity	RH40%~RH90%

Wiring specifications

Wiring type	Size	Total length
shielded vinyl cord or cable	0.5-1.25mm ²	≤50m (164')

5. Feature and function of the wired controller

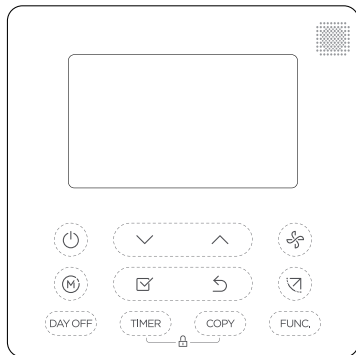


Feature:

- LCD display.
- Malfunction code display: it can display the error code, helpful for service.
- 4-way wire layout design, no raised part at backside, more convenient to place the wires and install the device.
- Room temperature display.
- Weekly Timer.

Function:

- Mode: choose Auto-Cool-Dry-Heat-Fan
- Fan speed: Auto/Low/Med/High speed
- Swing(on some models)
- Timer ON/OFF
- Temp setting
- Weekly timer
- Follow me
- Turbo
- 24-hour System
- 12-hour System
- 8 degree heating function (on some models)
- Sleep
- Auto-restart
- Individual louver control (on some models)
- Automatic airflow test
- Child Lock
- LCD display
- Clock

6. Name on the LCD of the wired controller

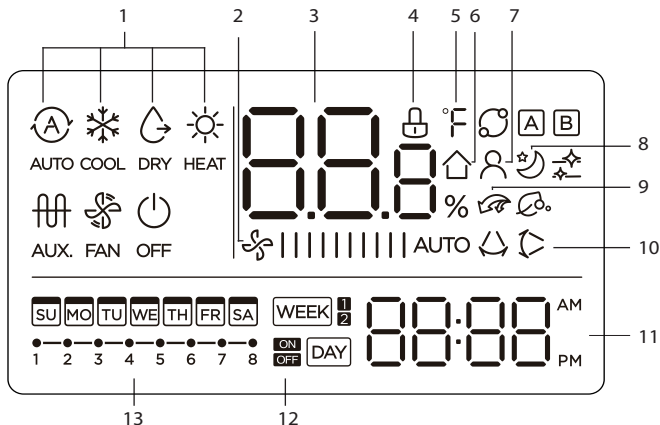

1 Operation mode indication

2 Fan speed indication

3 Temperature display

4 Lock indication

5 °C / °F indication

6 Room temperature indication

7 Follow Me function indication

8 Sleep mode indication

9 Electric Auxiliary Heat/

Turbo function indication(some models)

NOTE: AHU models only have turbo functions.

10 Left-right swing indication


(some models)

11 Clock display

12 On/Off timer

13 Timer display

7. Name of button on the wired controller

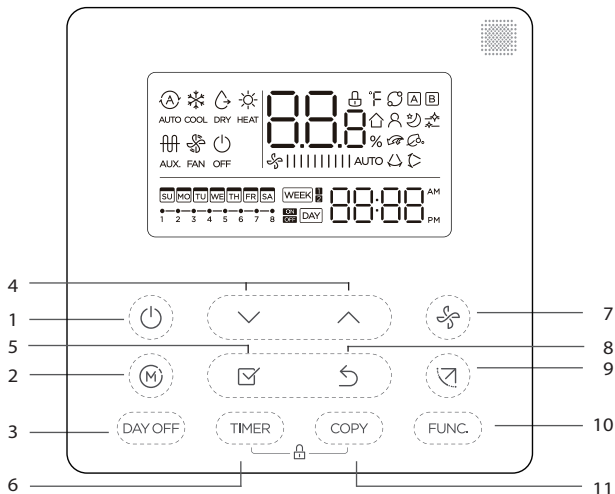

1 POWER button

2 MODE button

3 DAY OFF/DEL button

4 ADJUST button

5 CONFIRM button

6 TIMER button

7 FAN SPEED button

8 BACK button


9 SWING button



10 FUNC. button


11 COPY button



8. Preparatory operation


Set the current day and time

- 1  Press the Timer button for 2 seconds or more.
The timer display will flash.

- 2  Press the button "∨" or "∧" to set the date.
The selected date will flash.


- 3  The date setting is finished and the time setting is prepared after pressing Timer button or CONFIRM button or there is no pressing button in 10 seconds.

- 4  Press the button "∨" or "∧" to set the current time. Press repeatedly to adjust the current time in 1-minute increments. Press and hold to adjust the current time continuous.

ex.Monday 11:20

- 5  The setting is done after pressing CONFIRM button or there is no pressing button in 10 seconds.

9. Operation



Time scale selection

Press the buttons "TIMER" and "DAY OFF" for 2 seconds will alternatethe clock tieme display between the 12h&24h scale.

To start/stop operation



Press the Power button.

8 degree heating function (on some models)



When the heating mode is 16°C(60°F)/17°C (62°F)/20°C(68°F) , press the down button twice within 1 second to turn on the 8° heating function, and press the Power, Mode, adjust , Fan speed, Timer, and Swing button to cancel the 8° heating function.

NOTE:

For some models, the 8° heating function can only be set by remote control, you can not choose this function by wired controller.

9. Operation

To set the operation mode

Operation mode setting






Press the Mode button to set the operation mode.
(Heat function is invalid for cool only type unit)




For AHU models:



- When the mode is selected as emergency heating (single-on electric auxiliary heating) mode,  AUX. is displayed in the mode area, the fan speed display automatic wind, and the fan speed key does not respond.
- There is no sleep, 8-degree heating, turbo functions in emergency heating mode.
- When the mode is selected as heating + electric auxiliary heating mode,   HEAT AUX. is displayed in the mode area, and there is no turbo function.

9. Operation

Room temperature setting



Press the button " ∨ " or " ∧ " to set the room temperature.

Indoor Setting Temperature Range :
16-30°C(60~86°F) / 17~30°C(62~86°F) /
20~28°C(68~82°F) or according to the set
temperature range of the unit.


°C & °F scale selection(on some models)

Press the buttons " ∨ " and " ∧ " for 3 seconds
will alternate the temperature display between
the °C & °F scale.

Fan speed setting



Press the Fan speed button to set the fan speed.
(This button is unavailable when in the mode of
Auto or Dry)



keypad tone setting





Press the buttons Swing and FUNC. for 3
seconds to close the keypad tone.

Press the buttons again for 3 seconds to
open the keypad tone.


9. Operation

Child lock function



Press the buttons “  ” and “  ” for 2 seconds to activate the child lock function and lock all buttons on the wire controller.

Press the buttons again for 2 seconds to deactivate the child lock function.


When the child lock function is activated, the  mark appears.

Swing function(For the unit left & right auto swing models only)


1 Up-Down swing



Press the SWING button to start up-down swing function. Press it again to stop.

When the Up-Down swing function is activated, the  mark appears.

2 Left-Right swing

Press the Swing button long to start Left-Right swing function. Press it again to stop. When the Left-Right swing function is activated, the  mark appears.


9. Operation

Swing function(For the unit without left & right auto swing function models)

Up-Down airflow direction and swing




- Use Swing button to adjust the Up-down airflow direction.


- 1.Press the button every time, the louver swings 6 degrees.
- 2.Press and hold the button for 2 seconds,it turns into up-down swing mode,press ti again to stop. When the Up-Down swing function is activated,the  mark appears. (Not applicable to all the models)


- The operation can refer to the following instructions for the unit with four Up-Down louvers can be operated individually.



- 1.Press the Swing button to activate the Up-Down adjusting louver function.
The  mark will flash.(Not applicable to all the models)

9. Operation

2. Pressing the button "∨" or "∧" can select the movement of four louvers. Each time you push the button, the wire controller select in a sequence that goes from: (the icon  means the four louvers move at the same time.)



3. And then use Swing button to adjust the Up-Down airflow direction of the selected louver.



Press the FUNC. button to set the turbo or lfeel function.



The select function icon will flash then press the Confirm button to confirm the setting.



9. Operation

Sleep function




In automatic, cooling or heating mode, press the FUNC. button to select the sleep icon, and then press the CONFIRM button to turn on or off the sleep function, and set the wind speed to display as automatic wind.

After the sleep function is turned on, turning on turbo, 8-degree heating, switching modes, or adjusting the wind speed will cancel the sleep function.

Turbo function (on some models)



Under COOL/HEAT mode, press the FUNC. button to activate the turbo function. Press the button again to deactivate the turbo function.

When the turbo function is activated, the  mark appears. In heating mode, if there is a PTC, turn on the PTC function.


NOTE: The electric auxiliary heating function of the AHU model is switched by the MODE button, and the FUNC. button is a turbo function.

9. Operation

Follow me function indication

Press the FUNC. button to select whether the room temperature is detected at the indoor unit or the wire controller.

When the follow me function indication appears, the room temperature is detected at the wire controller.



Press the button again to cancel the follow me function.

10. Timer functions

WEEK

WEEKLY timer

Use this timer function to set operating times for each day of the week.

ON

DAY

On timer

Use this timer function to start air conditioner operation. The timer operates and air conditioner operation starts after the time has passed.

OFF

DAY

Off timer

Use this timer function to stop air conditioner operation. The timer operates and air conditioner operation stops after the time has passed.

ON
OFF

DAY

On and Off timer

Use this timer function to start and stop air conditioner operation. The timer operates and air conditioner operation starts and stops after the time has passed.

10. Timer functions

To set the On or Off TIMER

- 1 Press the Timer button to select the **ON** DAY or **OFF** DAY.



- 2 Press the Confirm button and the Timer display is flashing.



18:00

ex. Off timer set at 18:00




Press the button “ \vee ” or “ \wedge ” to set the time.
After the time is set, the timer will start or stop automatically.


- 4 Press the Confirm button again to finish the settings.






10. Timer functions


To set the On and Off TIMER

- 1  Press the Timer button to select the  .

- 2  Press the Confirm button and the Clock display is flashing.

- 3  Press the button "∨" or "∧" to set the time of On timer, and then press the Confirm button to confirm the setting.


- 4  Press the button "∨" or "∧" to set the time of Off timer.

- 5  Press the Confirm button to finish the settings.

11. Weekly Timer 1

1 Weekly timer setting



Press the Timer button to select the **WEEK** ¹ and then press the Confirm button to confirm.



2 Day of the week setting



Press the button “ \vee ” or “ \wedge ” to select the day of the week and then press the Confirm button to confirm the setting.



3 ON timer setting of timer setting 1



Press the button “ \vee ” or “ \wedge ” to set the time of On timer and then press the Confirm button to confirm the setting.



11. Weekly Timer 1



ex.Tuesday time scale 1

Up to 4 timer settings can be saved for each day of the week. It is convenient if the WEEKLY TIMER is set according to the user's life style.

4 Off timer setting of timer setting 1



Press the button "✓" or "∧" to set the time of Off timer and then press the Confirm button to confirm the setting.



ex.Tuesday time scale 1

- 5 Different timer settings can be set by repeating step 3 to 4.
- 6 Other days in one week can be set by repeating step 2 to 5.


NOTE: The weekly timer setting can be returned to the previous step by pressing Back button. The time of timer setting can be delete by pressing Day off botton The current setting will be restored and withdrawn the weekly timer setting automatically when there is no operation for 30 seconds.

11. Weekly Timer 1

WEEKLY timer operation

To activate WEEKLY TIMER operation

Press the Timer button while **WEEK** is displayed on the LCD.

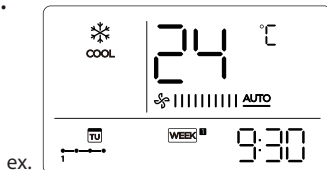


To deactivate WEEKLY TIMER operation

Press the Timer button while **WEEK** is disappear from the LCD.



To turn off the air conditioner during the weekly timer

1. If press the Power button once and quickly , the air conditioner will turn off temporarily. And the air conditioner will turn on automatically until the time of On timer.








ex. If press the POWER button once and quickly at 10:00,
The air conditioner will turn on at 14:00.

2. When press the Power button for 2 seconds , the air conditioner will turn off completely, at the same time cancel the timing function.

11. Weekly Timer 1

To set the DAY OFF (for a holiday)

-  During the weekly timer, press the Confirm button.
-  Press the button “∨” or “∧” to select the day in this week.
-  Press the Day off button to set the DAY OFF.


ex. The DAY OFF is set for Wednesday
- The DAY OFF can be set for other days by repeating the steps 2 and 3.
-  Press the Back button to back to the weekly timer.

To cancel: Follow the same procedures as those for setup.

Notes:



The DAY OFF setting is cancelled automatically after the set day has passed.

11. Weekly Timer 1

DELAY function



During the weekly timer, pressing the Del button once, display " 0h ". Press this button twice, display " 1h " and wait 3 seconds to confirm. It means the unit will override 1 hours; Press this button three times, display " 2h " and wait 3 seconds to confirm. It means the unit will override 2 hours;



ex. If press the DEL button to select " 2h " at 18:05 ,
The air conditioner will delay to turn off at 20:05.

Copy out the setting in one day into the other day.

A reservation made once can be copied to another day of the week. The whole reservation of the selected day of the week will be copied. The effective use of the copy mode ensures ease of making reservations.



During the weekly timer, press the Confirm button.



Press the button " ∨ " or " ∧ " to select the day to copy from.

11. Weekly Timer 1

3



Press the Copy button, the letter "CY" will be shown on the LCD.

4




Press the button "∨" or "∧" to select the day to copy to.

5



Press the Copy button to confirm.

The **WE** mark flashes quickly

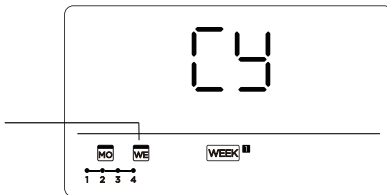

ex. Copy the setting of Monday to Wednesday


6 Other days can be copied by repeating step 4 and 5.

7



Press the Confirm button to confirm the settings.

8



Press the Back button to back to the weekly timer.

12. Weekly Timer 2

1 Weekly timer setting



Press **TIMER** to select the **WEEK** and press Confirm.

2 Day of the week setting



Press "∨" or "∧" to select the day of the week and then press CONFIRM.



3 ON timer setting of timer setting 1




Press "∨" or "∧" to select the setting time. The setting time, mode, temperature and fan speed appear on the LCD. Press CONFIRM to enter the setting time process.



12. Weekly Timer 2

IMPORTANT: Up to 8 scheduled events can be set on one day. Various events can be scheduled in either MODE, TEMPERATURE and FAN speeds.

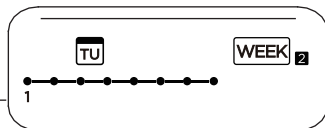


ex. Tuesday time scale 1

4 Time setting




Press “∇” or “∧” to set the time then press CONFIRM.

5 Operation mode setting




Press “∇” or “∧” to set the operation mode then press CONFIRM.



NOTE: The specific mode changes according to the mode of the actual model.

6 Room temperature setting



Press “∇” or “∧” to set the room temperature then press CONFIRM.
NOTE: This setting is unavailable in the FAN or OFF modes.

12. Weekly Timer 2


7 Fan speed setting



Press “ ∨ ” or “ ∧ ” to set the fan speed then press CONFIRM.



NOTE: This setting is unavailable in the AUTO, DRY or OFF modes.



8 Different scheduled events can be set by repeating steps 3 through 7.


9 Additional days, in a one week period, can be set by repeating steps 3 through 8.


NOTE: The weekly timer setting can be returned to the previous step by pressing BACK. The current setting is restored. The controller will not save the weekly timer settings if there is no operation within 30 seconds.

12. Weekly Timer 2

WEEKLY timer operation

To start

Press Timer to select the **WEEK** , and then the timer starts automatically.

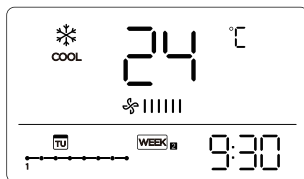

ex.

To cancel



Press the Power buttons for 2 seconds to cancel the timer mode.



The timer mode can also be canceled by changing the timer mode using Timer.

To set the DAY OFF (for a holiday)



After setting the weekly timer, press CONFIRM.




Press "✓" or "∧" to select the day of the week.

12. Weekly Timer 2

3



Press DAY OFF to create an off day.



ex.The DAY OFF is set for Wednesday

4 Set the DAY OFF for other days by repeating the steps 2 and 3.

5



Press BACK to revert to the weekly timer.

To cancel, follow the same procedures used for setup.

NOTE: The DAY OFF setting is cancelled automatically after the set day has passed.

Copy out the setting in one day into the other day.


A scheduled event, made once, can be copied to another day of the week. The scheduled events of the selected day of the week will be copied. The effective use of the copy mode ensures the ease of reservation making.


1




In the weekly timer, press CONFIRM.


12. Weekly Timer 2

2  Press "∨" or "∧" to select the day to copy from.

3  Press COPY, the letters CY appear on the LCD.

4  Press "∨" or "∧" to select the day to copy to.
5 Press COPY to confirm.


The **WE** mark flashes quickly

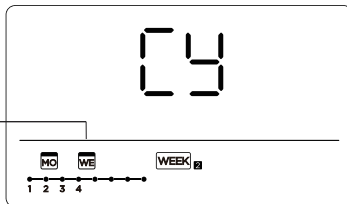

ex. Copy the setting of Monday to Wednesday

6 Other days can be copied by repeating steps 4 and 5.





7  Press CONFIRM to confirm the settings.

8  Press BACK to revert to the weekly timer.

12. Weekly Timer 2


Delete the time scale in one day.

1   During the weekly timer setting, press CONFIRM.

2  
  Press "∨" or "∧" to select the day of the week and then press CONFIRM.

3   

Press "∨" or "∧" to select the setting time want to delete. The setting time, mode, temperature and fan speed appear on the LCD. The setting time, mode, temperature and fan speed can be deleted by pressing the DEL (day off).

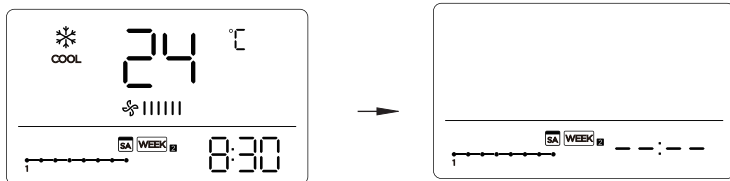

ex. Delete the time scale 1 in saturday

13. Fault alarm handing

If the system does not properly operate except the above mentioned cases or the above mentioned malfunctions is evident, investigate the system according to the following procedures.

NO.	MALFUNCTION & PROTECTION DEFINE	DISPLAY DIGITAL TUBE
1	Error of communication between wire controler and indoor unit	Eh63

The error displayed on the wire controller are different from those on the unit. If error code appears, please check the <<Owner's And Installation Manual>>and<<SERVICE Manual>>.

14. Technical indication and requirement

EMC and EMI comply with the CE certification requirements.

15.Queries and settings



When the air conditioning unit is switch machine, Long press "COPY" for 3 seconds to enter a query indoor unit Tn(T1~T4) temperature and fan fault(CF), press "v" or "^" to select.



Not operating keys 15 seconds or press "Back" or press "ON/OFF" drop out of query temperature.



When the air conditioning unit is off, into the query function of temperature, press "v" or "^" to select SP, press "Confirm" to adjust the static pressure value.



When the air conditioning unit is off, into the query function of temperature, press "v" or "^" to select AF, press "Confirm" into test mode, press "Back" or press "ON/OFF" or press "Confirm" drop out of test mode.

In AF mode, 3~6 minutes test completion automatically exits, if the test process, press "Back" or press "ON/OFF" or press "Confirm", the test exits will be interrupted.

15.Queries and settings

Follow me function temperature compensation



LF

When the air conditioning unit is off, into the query function of temperature, press“∨”or“∧”to select tF. The compensation temperature Range : -5~5°C. Press “Confirm” into setting state, press“∨”or“∧”to select the temperature, then press “Confirm” to complete it.

LF : compensation temperature



TYPE

When the air conditioning unit is off, into the query function of temperature, press“∨”or“∧”to select type. Press “Confirm” into setting state, press“∨”or“∧”to select the type, then press “Confirm” to complete it.

CH:     
AUTO COOL DRY HEAT FAN

CC:   
COOL DRY FAN

HH:  
HEAT FAN

NA:    
COOL DRY HEAT FAN

15.Queries and settings

Set the highest and lowest temperature values



When the air conditioning unit is off, into the query function of temperature, press "▽" or "△" to select tHi or tLo. Press "Confirm" into setting state, press "▽" or "△" to select the temperature, then press "Confirm" to complete it.

The highest setting temperature range : 25~30°C

The lowest setting temperature range: 17 ~24°C.

tHi : Highest value setting function.

tLo : Minimum value setting function.

Remote control function selection of wire controller



When the air conditioning unit is off, into the query function of temperature, press "▽" or "△" to select rEC. ON or OF will be displayed in the temperature area to indicate whether it is valid or invalid.

When the selection is invalid, the wire controller does not process any remote control signals.

Press "Confirm" into setting state, press "▽" or "△" to select , then press "Confirm" to complete it.

15.Queries and settings

Restore factory Settings



When the air conditioning unit is off, into the query function of temperature, press "∨" or "∧" to select INIt, the temperature zone displayed --.

Press "Confirm" into setting state, press "∨" or "∧" to select to "ON", then press "Confirm" to complete it.



||||| : Restore factory Settings .

After the wire controller resumes the factory parameter setting, compensation of body temperature is uncompensated; COOL and HEAT/single COOL mode is restored to COOL and HEAT model; The temperature range was restored to 16-30°C(60~86°F) / 17~30°C(62~86°F) or 20~28°C(68~82°F) . Remote receiving function is restored to be effective.

The design and specifications are subject to change without prior notice for product improvement. Consult with the sales agency or manufacturer for details.

QX002IU-120X2
16117100002914
20240327